

**Cable Gland Type LT-C\*** (Single Compression Peppers T-1000 Compound Barrier Gland featuring a Connector for Liquid Tight Flexible Metallic Conduit)

Ex db : Ex e : Ex ta : IP66 : IP68


Part Numbers:

L	T	C	B
			S



“LT-C” type glands are certified Flameproof Ex db, Increased Safety Ex e and Dust Protected Ex ta. They are suitable for use in Zone 1 and 2 for Gas Groups IIA, IIB and IIC and additionally for use in Zones 20, 21 and 22 for Dusts Groups IIIA, IIIB and IIIC. Occasionally referred to as “potting glands”, they provide a compound barrier Ex db & IP seal on the cable inner cores, eliminating damage to cables that exhibit “cold flow” characteristics. The gland maintains IP66 & IP68 to 100 metres. The gland incorporates a connection for liquid tight flexible metallic conduit and features the Peppers T-1000 sealing compound that enables a quick and easy installation.

<b>Compliance Standards:</b>	EN 60079-0, EN 60079-1, EN 60079-7, EN 60079-31 IEC 60079-0, IEC 60079-1, IEC 60079-7, IEC 60079-31 & IEC 60529
<b>Certification:</b>	ATEX I M2 II D 2G Ex db I Mb / Ex db IIC Gb / Ex e I Mb / Ex e IIC Gb / Ex ta IIIC Da IECEX Ex db I Mb / Ex db IIC Gb / Ex e I Mb / Ex e IIC Gb / Ex ta IIIC Da CCoE - India Petroleum Rules 2002 (PESO) LLOYD'S Enclosure Systems (Part 1B)
<b>Certificate No.</b>	ATEX SIRA 14ATEX1303X IECEX IECEX SIR 14.0106X CCoE - India PESO P365300/1 LLOYD'S 10/00056(E1)
<b>IP Rating:</b>	IP66 & IP68 (100 metres - 7 Days ) & DTS01:1991
<b>Operating Temperature:</b>	-60°C to +135°C
<b>Materials:</b>	Brass or Stainless Steel
<b>Plating:</b>	Nickel, Zinc
<b>Compound:</b>	Peppers T-1000 Sealing Compound

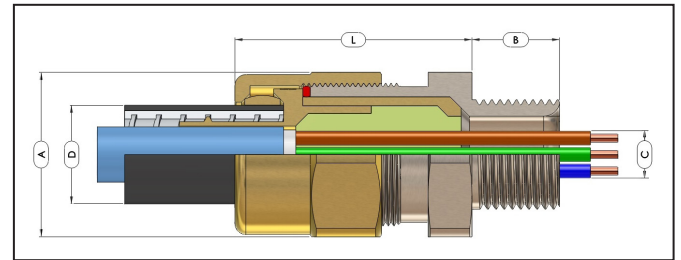

**Example Part Numbering** LT-CB/NP/20-1/M20  
(See below for details)

<b>LT-C</b>	Gland featuring Peppers T-1000 Compound and connection for liquid tight flexible metallic conduit
<b>B</b>	Brass (B) / Stainless Steel (S)
<b>L</b>	Locknut (material dictated by gland entry thread material)
<b>H</b>	Including IP Washer, Nylon [N] - Fibre [V] - PTFE [H]
<b>T</b>	Including Earth Tag
<b>S</b>	Including Serrated Washer
<b>1</b>	Quantity per kit
<b>NP</b>	Nickel Plated (NP) - Zinc Plated (ZP)
<b>20-1</b>	Gland and Conduit Connection Size
<b>M20</b>	M20 x 1.5 Male Entry Thread
<b>Optional Accessories</b>	Locknut Brass (ACBLN) / Stainless Steel (ACSLN)
	Earth tag Brass (ACBET) / Stainless Steel (ACSET)
	IP Washers Nylon (ACNSW) / Fibre (ACFSW) / PTFE (ACPSW)
	Serrated Washers Stainless Steel (ACSSW)

**Curing Time:** @ 21°C  
Conductor termination can be effected after 1 hour  
Compound chamber can be fully inspected after 4 hours and the equipment then energised

Gland & Connection Size	Standard Entry Thread Size		Metric Thread Length [B]	Cable Acceptance Details [C]			Conduit Data [D]		Nominal Protrusion Length [L]	Dimensions/Weight (Metric Versions)		
	Metric	NPT		Max No. of Cores	Max Ø Over Cores	Max Cable Inner Sheath Ø	Typical Conduit I/D	Max Conduit O/D		Across Flats [A]	Across Corners	Weight Kgs
20S-1	M20 x 1.5	½" or ¾"	16	9	5.0	5.0	6.2 - 7.1	11.4 - 12.9	45.0	25.4	28.0	0.180
20S-2	M20 x 1.5	½" or ¾"	16	20	7.8	7.8	9.8 - 10.3	14.2 - 15.6	44.0	25.4	28.0	0.177
20-1	M20 x 1.5	½" or ¾"	16	35	10.4	10.4	12.1 - 13.0	17.0 - 19.1	44.0	30.0	33.0	0.217
20-2	M20 x 1.5	½" or ¾"	16	40	12.5	13.0	15.8 - 16.3	20.8 - 22.3	42.0	30.0	33.0	0.218
25-1	M25 x 1.5	¾" or 1"	16	60	17.8	18.0	20.8 - 21.3	26.0 - 27.8	46.0	41.3	45.4	0.364
32-1	M32 x 1.5	1" or 1 ¼"	16	80	23.5	23.5	26.0 - 27.1	32.7 - 34.5	54.0	46.0	50.6	0.482
40-1	M40 x 1.5	1 ¼" or 1 ½"	16	130	28.8	29.8	34.8 - 35.8	41.1 - 43.3	57.0	55.0	60.5	0.706
50-1	M50 x 1.5	2"	16	200	35.2	35.2	40.0 - 40.6	47.3 - 49.4	66.0	65.0	71.5	0.989
63-1	M63 x 1.5	2" or 2 ½"	19	300	48.0	48.0	50.5 - 51.9	59.4 - 61.4	67.0	80.0	88.0	1.410
75-1	M75 x 1.5	2 ½" or 3"	19	325	59.3	59.3	62.9 - 63.9	72.1 - 74.1	67.0	98.8	108.7	1.945
75-2	M75 x 1.5	2 ½" or 3"	19	425	60.8	68.0	77.9 - 78.7	87.8 - 90.0	67.0	104.7	115.2	2.338

All dimensions in mm

- Notes:
- \* Gland size does not necessarily equate to the entry thread size.
  - \* All brass entry threads are Nickel Plated as standard.
  - \* Dimensions (A) & (B) may differ for glands with non metric entry threads. Please refer to our "Thread Reference Tables" for specific dimensions.
  - \* Assembly instructions must be read prior to installation and adhered to in full.
  - \* Peppers supplies cable glands with parallel entry threads that conform to the flameproof threaded joint requirements of IEC/EN 60079-1 and other equivalent standards. They usually incorporate a thread run out according to the available machining techniques and will not have a full form thread for the entire length. Peppers will not be held responsible for clients' installations where this has not been taken into account.
  - \* It is the installers responsibility to ensure that the conduit is secured correctly
  - \* The gland is supplied with the correct amount of the two-part compound, gloves and instructions to allow one complete termination.
  - \* If fit testing is required for specific conduit please contact Peppers.
  - \* When selecting IP Washer material for use with glands, please be aware of the accessories temperature range to ensure they are suitable for the intended installation
  - \* Where approval in addition to ATEX, and IECEx is required, this must be clearly requested at time of enquiry / order.